




C-Bus Infrared Remote Control

User's Guide

5084TX

5088TX

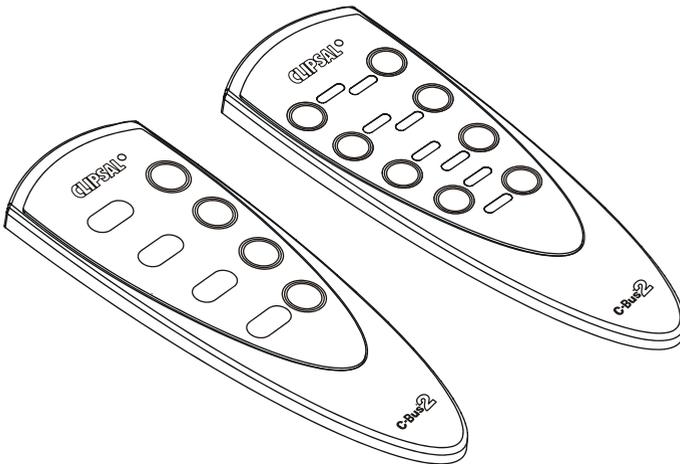

© Copyright Clipsal Integrated Systems Pty Ltd 2005. All rights reserved. This material is copyright under Australian and international laws. Except as permitted under the relevant law, no part of this work may be reproduced by any process without prior written permission of and acknowledgement to Clipsal Integrated Systems Pty Ltd.

Clipsal is a registered trademark of Clipsal Australia Pty Ltd.

The information in this manual is provided in good faith. Whilst Clipsal Integrated Systems (CIS) has endeavoured to ensure the relevance and accuracy of the information, it assumes no responsibility for any loss incurred as a result of its use. CIS does not warrant that the information is fit for any particular purpose, nor does it endorse its use in applications which are critical to the health or life of any human being. CIS reserves the right to update the information at any time without notice.

V1.0 Mar 2005

Contents

1.0	Product Range	5
2.0	Description	5
3.0	Operation	6
	3.1 Bank Selection	7
4.0	Installing the Batteries	9
5.0	Electrical Specifications	10
6.0	Warranty	11

1.0 Product Range

5084TX	4 Button C-Bus Infrared Remote Control
5088TX	8 Button C-Bus Infrared Remote Control

2.0 Description

The 508xTX Series Infrared Remote Controls are designed for use with the C-Bus Neo range of switch plates. They have a range of up to 15 metres.

The remotes feature a Bank selection switch, so you can specify which Neo switch plate to control (when multiple Neo units are configured with different bank settings).

3.0 Operation

Each button on a 508xTX Series Infrared Remote Control operates a specific button on a Neo switch plate. The buttons on an 8 button 5088TX remote match the positions of the buttons on the Neo they control. The buttons on a 4 button 5084TX remote, control the buttons of a 2 or 4 button Neo, and either the first or last four buttons of an 8 button Neo (depending on the Bank selection switch described in section 3.1).

This is illustrated in Figure 1, which shows the button assignments when the Neo and remote are configured with the default bank settings.

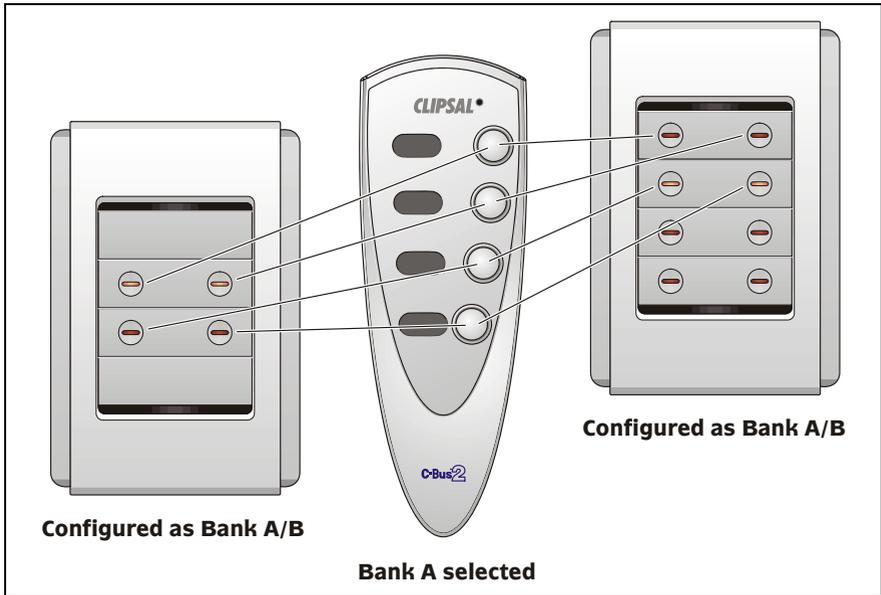


Figure 1 – Neo buttons controlled by a 4 button 5084TX remote

For the purpose of infrared control, the buttons on a Neo unit are organised in banks. Each group of four buttons is assigned to one of two banks, identified as A, B, C or D, depending on the button number and how the Neo has been configured by the installer. The ability to assign Neo buttons to different banks, means that two Neo switch plates can be operated by separate IR remotes.

Figure 2 shows the banks to which Neo buttons may be assigned by the installer. Most Neo switch plates are configured as Bank A on a 2 or 4 button Neo and Banks A and B on an 8 button Neo. The alternative is Bank C on a 2 or 4 button Neo and Banks C and D on an 8 button Neo.

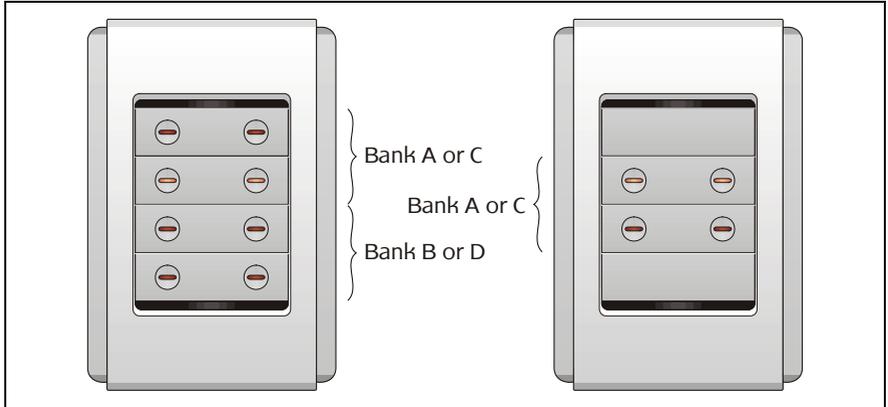


Figure 2 - Neo bank assignments

3.1 Bank Selection

The bank selection of the remote is changed by removing the back cover and sliding the Bank switch across to the required position.

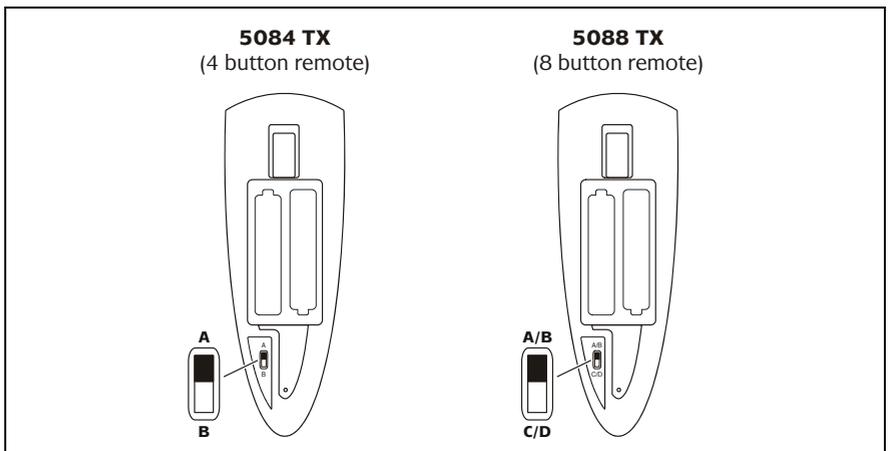


Figure 3 - The Bank selection switch is located behind the back cover

4 Button Remote

The 4 button 5084TX remote will only control a Neo switch plate which has been configured as Banks A and B (by the installer). When the remote is set to Bank A, it will control a 2 or 4 button Neo, and the first four buttons of an 8 button Neo (as shown in Figure 4). When set to Bank B, it will control the last four buttons of an 8 button Neo.

8 Button Remote

The 8 button 5088TX remote will control a Neo switch plate which has been configured with the same Banks as the remote. If the remote will not control your Neo, simply change the Bank selection switch.

 **NOTE** The infrared control capability of a Neo switch plate unit may be disabled by a C-Bus installer.

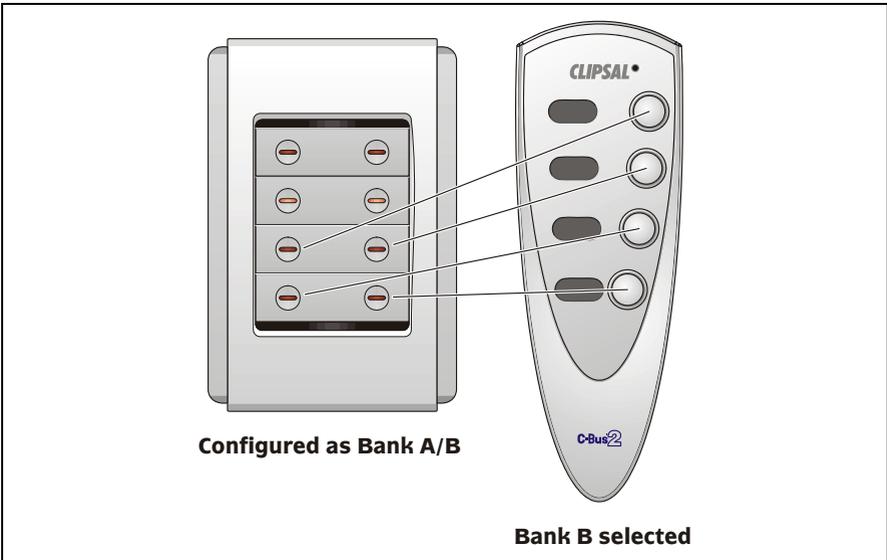


Figure 4 – Controlling a Neo when the 4 button 5084TX remote is set to Bank B

4.0 Installing the Batteries

The 508xTX Series Infrared Remote Controls use 2 × AAA batteries. Alkaline batteries are recommended. To install the batteries:

- 1) Turn the remote upside down.
- 2) Press the tab and slide the back cover down to release (refer to Figure 5).
- 3) Insert the batteries. Ensure the \oplus and \ominus terminals match the symbols inside the battery compartment.
- 4) Replace the back cover (position and slide up).


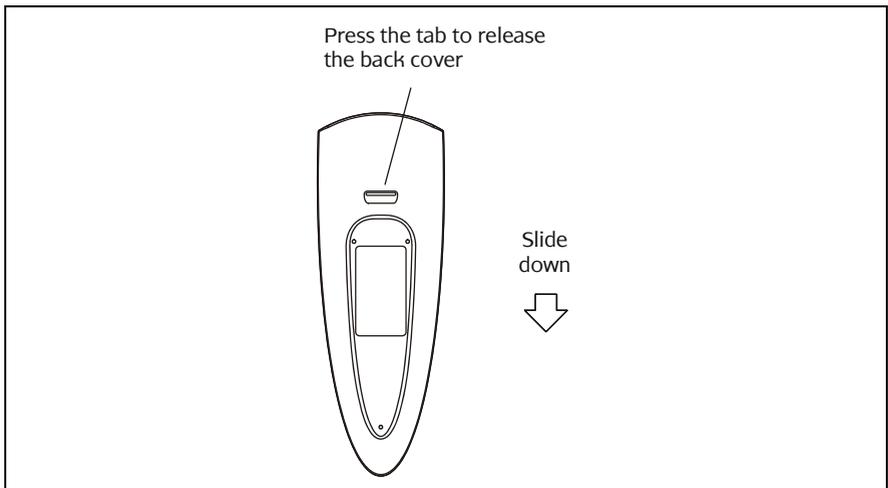


Figure 5 – Removing the back cover to access the battery compartment

5.0 Product Specifications

Parameter	Description
Supply Voltage	3 V DC required for normal operation
Battery type	2 × AAA alkaline
Infrared transmission range	up to 15 m
Dimensions (W×H×D)	149 × 52 × 33 mm
Weight (excluding batteries)	61 g (5084TX), 62 g (5088TX)

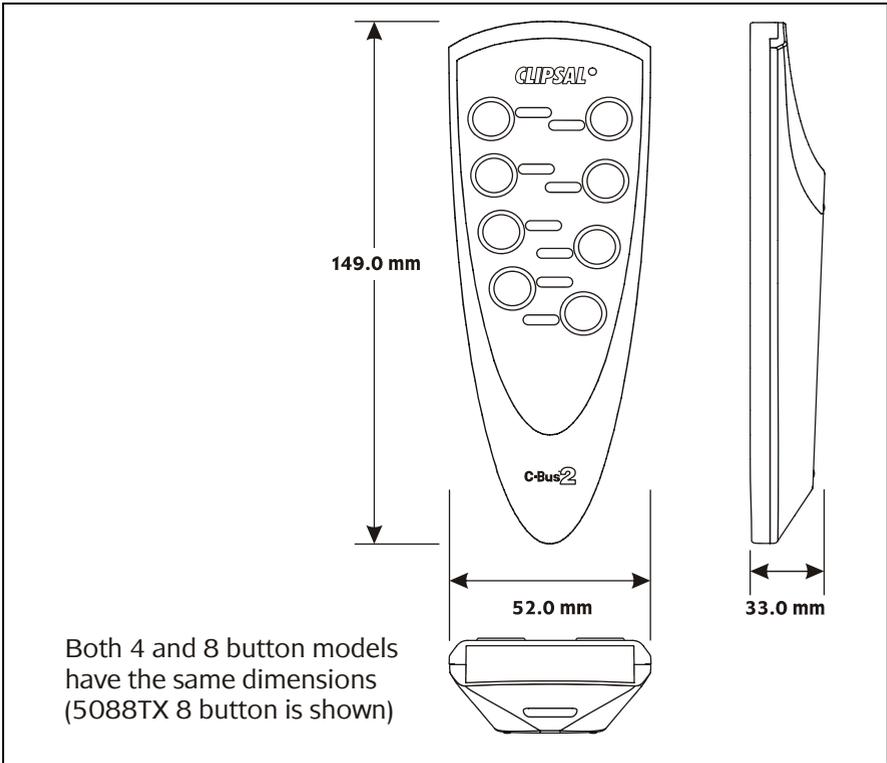

6.0 Warranty

The 508xTX Series Infrared Remote Controls carry a two year warranty against manufacturing defects (refer to the Warranty Statement).



Technical Support and Troubleshooting

For further assistance in using this product, consult your nearest Clipsal Integrated Systems Sales Representative or Technical Support Officer.

Technical Support Hotline: 1300 722 247 (Australia)
0800 888 219 (New Zealand)

Technical Support Email: techsupport.cis@clipsal.com.au

Sales Support Email: sales.cis@clipsal.com.au

A list of worldwide contacts, additional product information and technical resources is provided at <http://www.clipsal.com/cis/>

Product of Clipsal Integrated Systems Pty Ltd

ABN 15 089 444 931

Head Office

12 Park Terrace, Bowden, SA 5007, Australia

Telephone: (+61) 8 8440 0500

Facsimile: (+61) 8 8346 0845

Email: cis@clipsal.com.au

Web: <http://www.clipsal.com/cis/>

1036549